



ICC-ES Listing Report

Reissued February 2025

ESL-1254

This listing is subject to renewal February 2026.

CSI: DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION
Section: 07 42 43—Composite Wall Panels

Product Certification System:

The ICC-ES product-certification system includes evaluating reports of tests of standard manufactured product, prepared by accredited testing laboratories and provided by the listee, to verify compliance with applicable codes and standards. The system also involves factory inspections, and assessment and surveillance of the listee's quality system.

Product: OMEGA-LITE® ACM PANELS

Listee: LAMINATORS INC.

Evaluation: Omega-Lite® ACM panels are prefabricated panels consisting of a 0.185-inch (4.7 mm) thick extruded polypropylene core bonded to an unfinished 0.013-inch (0.33 mm) thick aluminum backer sheet on one side and a finished 0.028-inch (0.71 mm) thick aluminum sheet on the other side to create an overall panel thickness of 0.24-inch (6 mm) nominal; the panels were evaluated when tested in accordance to the following standard:

- ASTM E283-04 (12), Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen, ASTM International.

Findings: Omega-Lite® ACM panels when used in various installations systems have an air infiltration rate at 6.24 psf (300 Pa) as specified in Table 1 below based on testing in accordance with ASTM E283. See Figures 1-2 for details.

TABLE 1—AIR INFILTRATION RATE RESULTS OF INSTALLATION SYSTEMS USING OMEGA-LITE® ACM PANELS

	INSTALLATION SYSTEMS	
	CLIP & CAULK SYSTEM WITH VERTICAL LAYOUT OF BD&V SUB-FRAMING OVER OMEGA CI (Figure 1)	1-PIECE, TIGHT-FIT MOLDING SYSTEM WITH VERTICAL LAYOUT OF BD&V SUB-FRAMING OVER OMEGA CI (Figure 2)
AIR INFILTRATION RATE	0.06 cfm/ft ² (0.3 L/s/m ²)	<0.01 cfm/ft ² (0.1 L/s/m ²)

Identification:


1. Packaging of the Omega-Lite® ACM panels carry a label indicating the manufacturer's name (Laminators Inc.) and address, the product name (Omega-Lite® ACM panels), ICC-ES listing number (ESL-1254), and when applicable, the ICC-ES listing mark.
2. The report holder's contact information is the following:

LAMINATORS INC.
3255 PENN STREET
HATFIELD, PENNSYLVANIA 19440
(877) 663-4277
www.laminatorsinc.com

Installation: The product must be installed in accordance with Laminators Inc's published installation instructions and applicable codes.


Conditions of Listing:

1. The listing report addresses only conformance with the standard and code sections noted above.
2. Approval of the product's use is the sole responsibility of the local code official.
3. The listing report applies only to the materials tested and as submitted for review by ICC-ES.
4. The Omega-Lite® ACM panels are manufactured under a quality control program with inspections by ICC-ES.

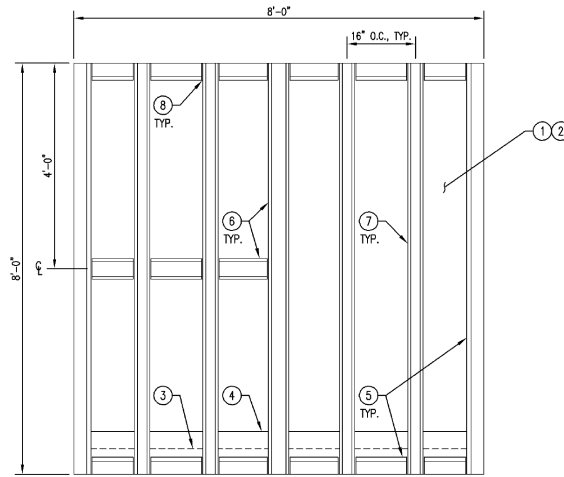

- ① OMEGA CI RIGID INSULATION PANELS (4' X 8' SHEETS, 2.1" THICK)
 - PANELS CONSIST OF CLOSED-CELL, POLYISOCYANURATE FOAM BONDED TO A COATED GLASS BACKER AND 5/8" FIRE-TREATED PLYWOOD AS AN EXTERIOR FACE
 - PANELS INSTALLED ON WALL ASSEMBLY COMPRISING EXTERIOR-GRADE GYPSUM SHEATHING INSTALLED OVER STEEL STUDS
 - PANELS FASTENED TO STUD FRAMING USING 1/4" X 3-3/4" FPH WINGED REAMERS INSTALLED AT 8" O.C. SPACING ALONG PERIMETERS AND 16" O.C. VERTICAL SPACING ALONG STUDS
 - SELF-ADHERING MEMBRANE FLASHING APPLIED TO BOTTOM EDGE OF OMEGA CI PANELS AND WRAPPED 2" (MIN) ON EACH VERTICAL FACE INCLUDING ENDS (NOT SHOWN)
 - ② HENRY AIR-BLOC 31MR FLUID-APPLIED AIR AND WATER BARRIER
 - ③ METAL BASE WALL FLASHING
 - ④ SELF-ADHERING MEMBRANE FLASHING LAPPED OVER TOP OF METAL BASE WALL FLASHING IN SHINGLE FASHION
 - ⑤ EJ SUB-FRAMING MEMBERS INSTALLED ALONG PERIMETER OF INSTALLATION; CONTINUOUS MEMBERS AT VERTICAL EDGES AND DISCONTINUOUS MEMBERS FIT BETWEEN FLANGES OF VERTICAL MEMBERS AT HORIZONTAL EDGES
 - ⑥ SH SUB-FRAMING MEMBERS INSTALLED ALONG PANEL JOINTS; CONTINUOUS MEMBERS AT VERTICAL JOINT AND DISCONTINUOUS MEMBERS FIT BETWEEN FLANGES OF VERTICAL MEMBERS AT HORIZONTAL JOINT
 - ⑦ CONTINUOUS AH SUB-FRAMING MEMBERS INSTALLED AT 16" O.C. SPACING BETWEEN VERTICAL EJ AND SH MEMBERS
 - ⑧ MESH VENT MATERIAL PLACED INTO GAPS BETWEEN HORIZONTAL AND VERTICAL MEMBERS AT TOP AND BOTTOM OF WALL (NOT SHOWN)
- NOTE: TESTING BUCK NOT SHOWN FOR CLARITY


NOTE: THIS DETAIL IS APPLICABLE TO BOTH HORIZONTAL AND VERTICAL JOINTS

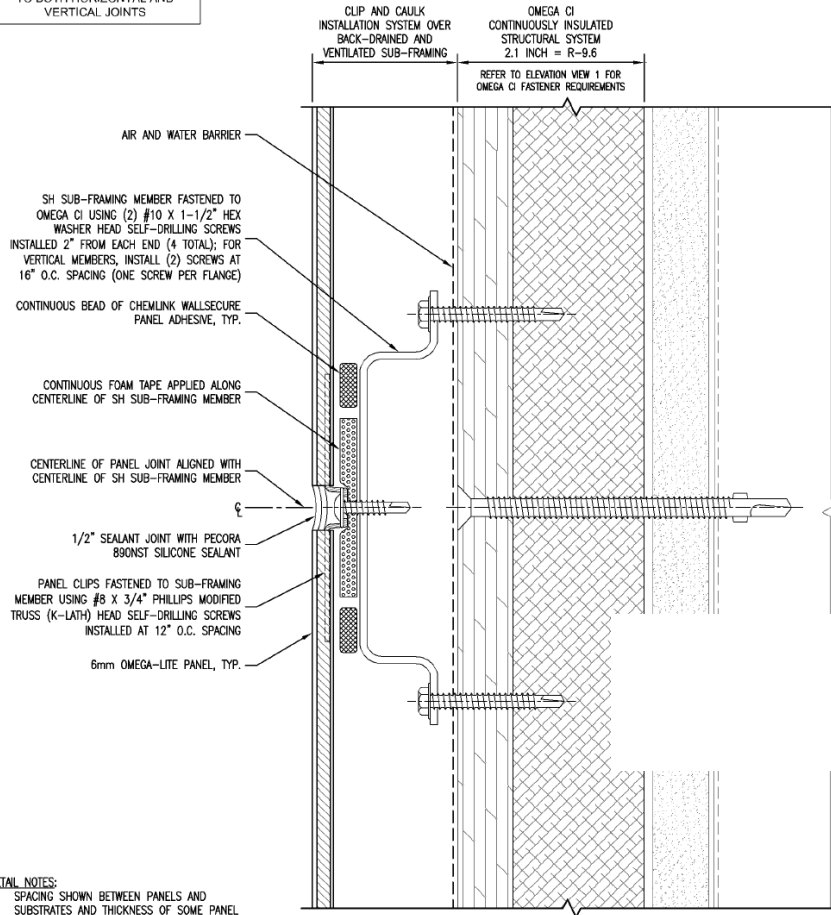

- DETAIL NOTES:
1. SPACING SHOWN BETWEEN PANELS AND SUBSTRATES AND THICKNESS OF SOME PANEL SYSTEM COMPONENTS EXAGGERATED FOR CLARITY
 2. REFER TO ELEVATION VIEWS FOR LAYOUT OF SUB-FRAMING MEMBERS, FOAM TAPE, AND PANEL ADHESIVE

SECTION A - TYPICAL JOINT DETAIL


FIGURE 1—CLIP & CAULK INSTALLATION SYSTEM WITH VERTICAL LAYOUT OF BD&V SUB-FRAMING OVER OMEGA CI

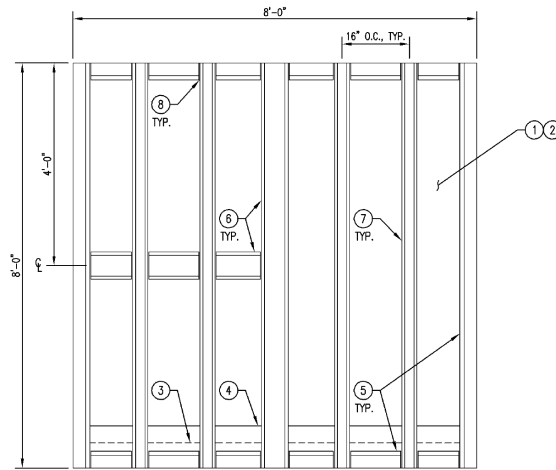

- ① OMEGA CI RIGID INSULATION PANELS (4' X 8' SHEETS, 2.1" THICK)
 - PANELS CONSIST OF CLOSED-CELL, POLYISOCYANURATE FOAM BONDED TO A COATED GLASS BACKER AND 5/8" FIRE-TREATED PLYWOOD AS AN EXTERIOR FACE
 - PANELS INSTALLED ON WALL ASSEMBLY COMPRISING EXTERIOR-GRADE GYPSUM SHEATHING INSTALLED OVER STEEL STUDS
 - PANELS FASTENED TO STUD FRAMING USING 1/4" X 3-3/4" FPH WINGED REAMERS INSTALLED AT 8" O.C. SPACING ALONG PERIMETERS AND 16" O.C. VERTICAL SPACING ALONG STUDS
 - SELF-ADHERING MEMBRANE FLASHING APPLIED TO BOTTOM EDGE OF OMEGA CI PANELS AND WRAPPED 2" (MIN) ON EACH VERTICAL FACE INCLUDING ENDS (NOT SHOWN)
- ② HENRY AIR-BLOC 31MR FLUID-APPLIED AIR AND WATER BARRIER
- ③ METAL BASE WALL FLASHING
- ④ SELF-ADHERING MEMBRANE FLASHING LAPPED OVER TOP OF METAL BASE WALL FLASHING IN SHINGLE FASHION
- ⑤ EJ SUB-FRAMING MEMBERS INSTALLED ALONG PERIMETER OF INSTALLATION; CONTINUOUS MEMBERS AT VERTICAL EDGES AND DISCONTINUOUS MEMBERS FIT BETWEEN FLANGES OF VERTICAL MEMBERS AT HORIZONTAL EDGES
- ⑥ RH SUB-FRAMING MEMBERS INSTALLED ALONG PANEL JOINTS; CONTINUOUS MEMBERS AT VERTICAL JOINT AND DISCONTINUOUS MEMBERS FIT BETWEEN FLANGES OF VERTICAL MEMBERS AT HORIZONTAL JOINT
- ⑦ CONTINUOUS AH SUB-FRAMING MEMBERS INSTALLED AT 16" O.C. SPACING BETWEEN VERTICAL EJ AND RH MEMBERS
- ⑧ MESH VENT MATERIAL PLACED INTO GAPS BETWEEN HORIZONTAL AND VERTICAL MEMBERS AT TOP AND BOTTOM OF WALL (NOT SHOWN)

NOTE: TESTING BUCK NOT SHOWN FOR CLARITY

NOTE: THIS DETAIL IS APPLICABLE TO BOTH HORIZONTAL AND VERTICAL JOINTS

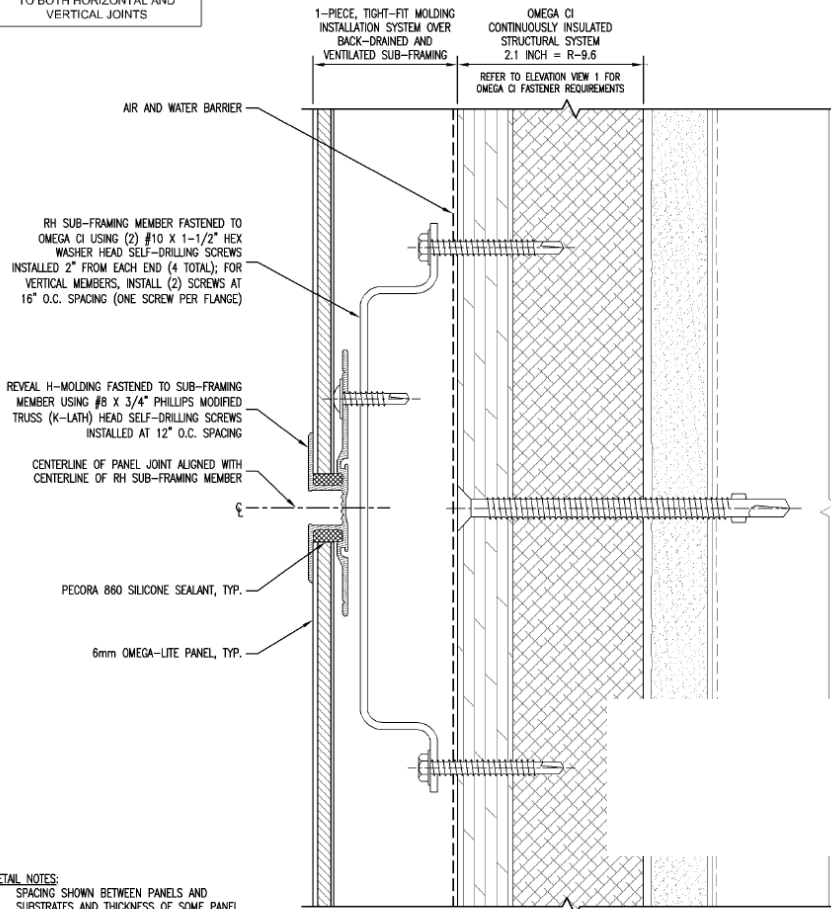

- DETAIL NOTES:
1. SPACING SHOWN BETWEEN PANELS AND SUBSTRATES AND THICKNESS OF SOME PANEL SYSTEM COMPONENTS EXAGGERATED FOR CLARITY
 2. REFER TO ELEVATION VIEWS FOR LAYOUT OF SUB-FRAMING MEMBERS, FOAM TAPE, PANEL ADHESIVE, AND MOLDINGS

SECTION A - TYPICAL JOINT DETAIL

FIGURE 2—1-PIECE, TIGHT-FIT MOLDING INSTALLATION SYSTEM WITH VERTICAL LAYOUT OF BD&V SUB-FRAMING OVER OMEGA CI